



NOTES:

1. ADDITIONAL POLE HEIGHT MAY BE REQUIRED BY CUB ENGINEERING REPRESENTATIVE.
2. THE ENTIRE INSTALLATION BY CUSTOMER IS SUBJECT TO INSPECTION AND APPROVAL BY THE STATE OF TN ELECTRICAL INSPECTOR.
3. SERVICE ENTRANCES AND VOLTAGES OTHER THAN SPECIFIED IN THIS DETAIL WILL REQUIRE CUB REVIEW AND APPROVAL; ADDITIONAL REQUIREMENTS MAY APPLY.

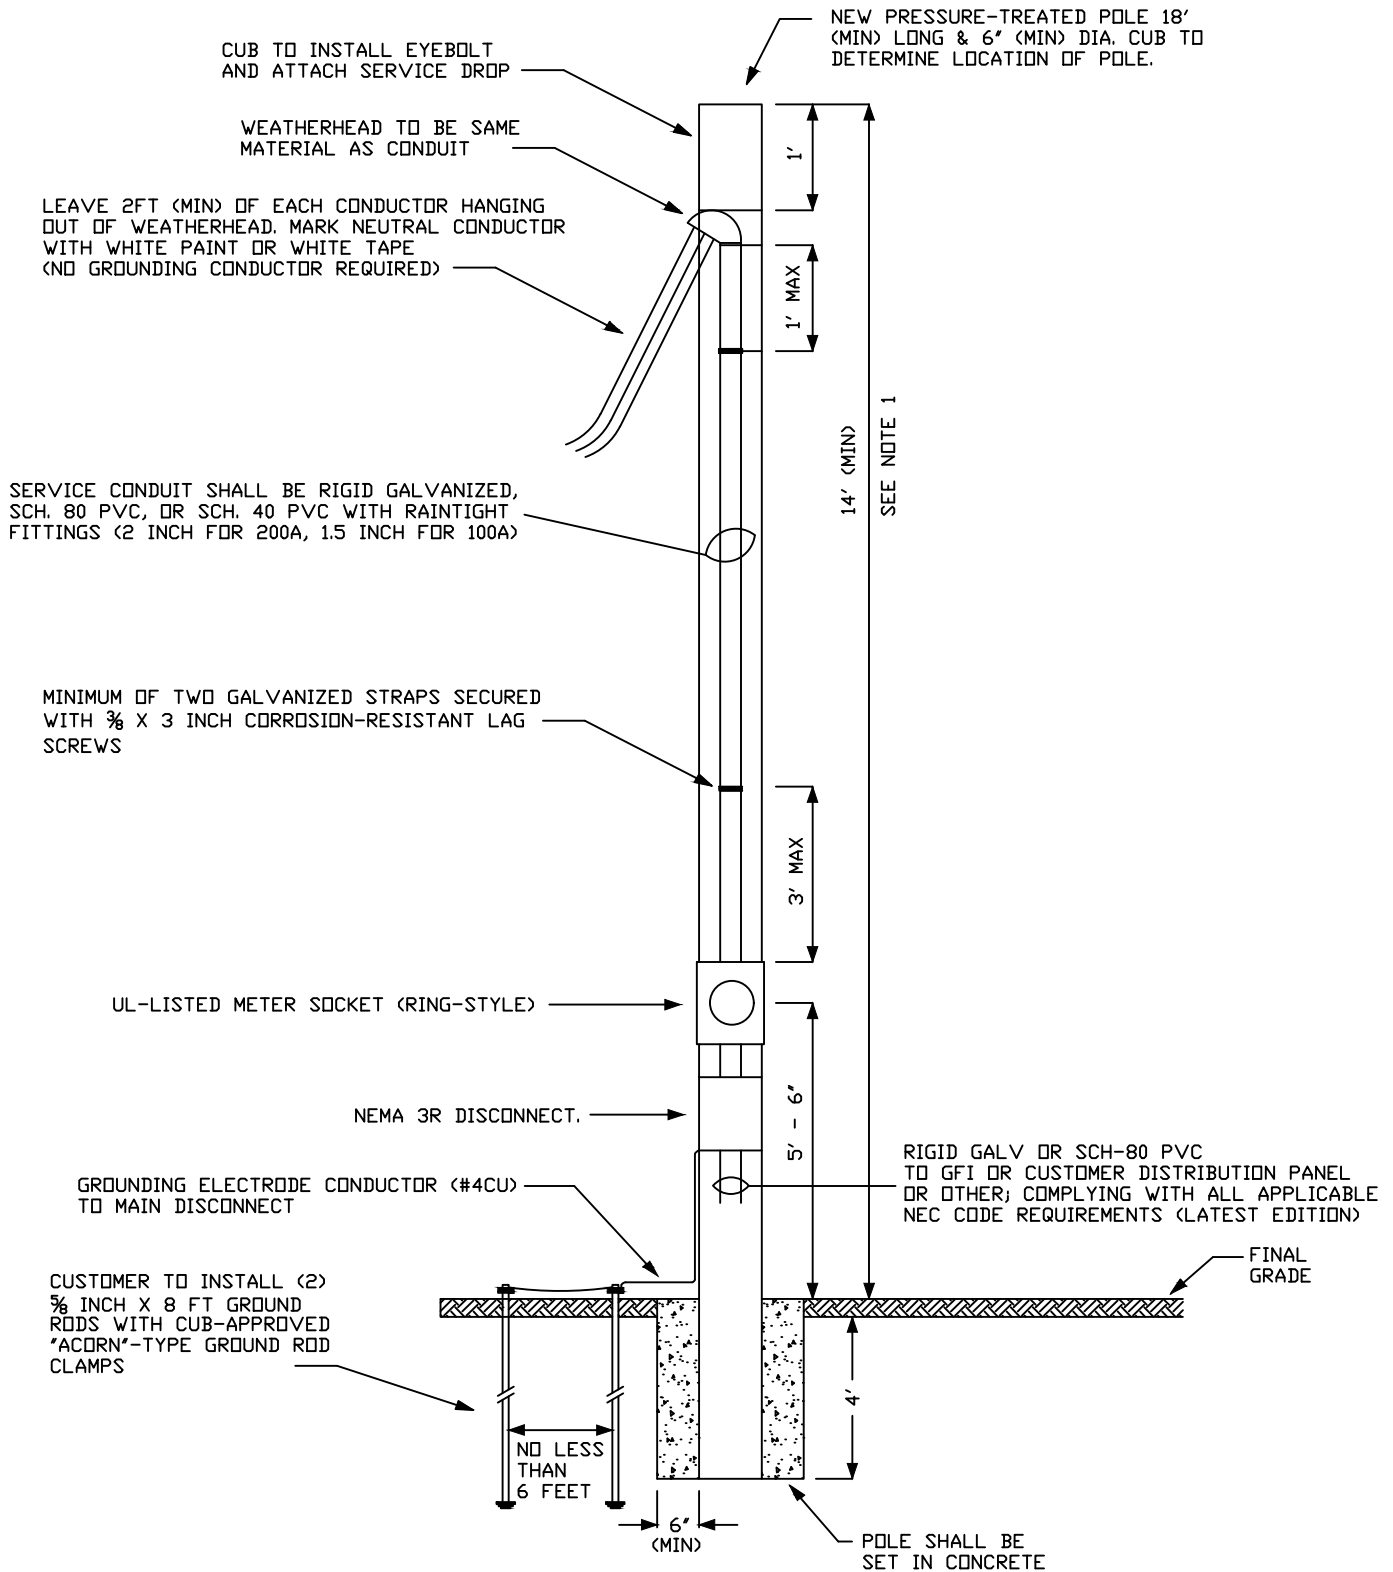

CLINTON UTILITIES BOARD
 General Delivery Overhead Service Detail
 1-Phase, 3-Wire, 120/240 Volts

Rev. Date:	Submitted:	Approved:	SVC-GDP
JAN. 2020	DM	TL	