


NOTES:


1. IF LENGTH OF CONDUIT EXCEEDS 10FT, USE 10FT SECTION AT WEATHERHEAD FOR SERVICE MAST WITH COUPLING TO BE LOCATED NEAR METER SOCKET. IF CONDUIT LENGTH IS 10FT OR LESS, USE A SINGLE SECTION OF CONDUIT BETWEEN METER SOCKET AND WEATHERHEAD.
2. THE ENTIRE INSTALLATION BY CUSTOMER IS SUBJECT TO INSPECTION AND APPROVAL BY THE ELECTRICAL INSPECTOR. REQUIREMENTS BY THE ELECTRICAL INSPECTOR SHALL PREVAIL OVER ANY CONFLICTING REQUIREMENTS OF THIS DRAWING.
3. PRIOR TO INSTALLATION, THE LOCATION OF THE METER BASE AND CONDUIT RISER MUST BE ESTABLISHED AND APPROVED BY CUB.

CUSTOMER TO INSTALL RIGID METAL WEATHERHEAD

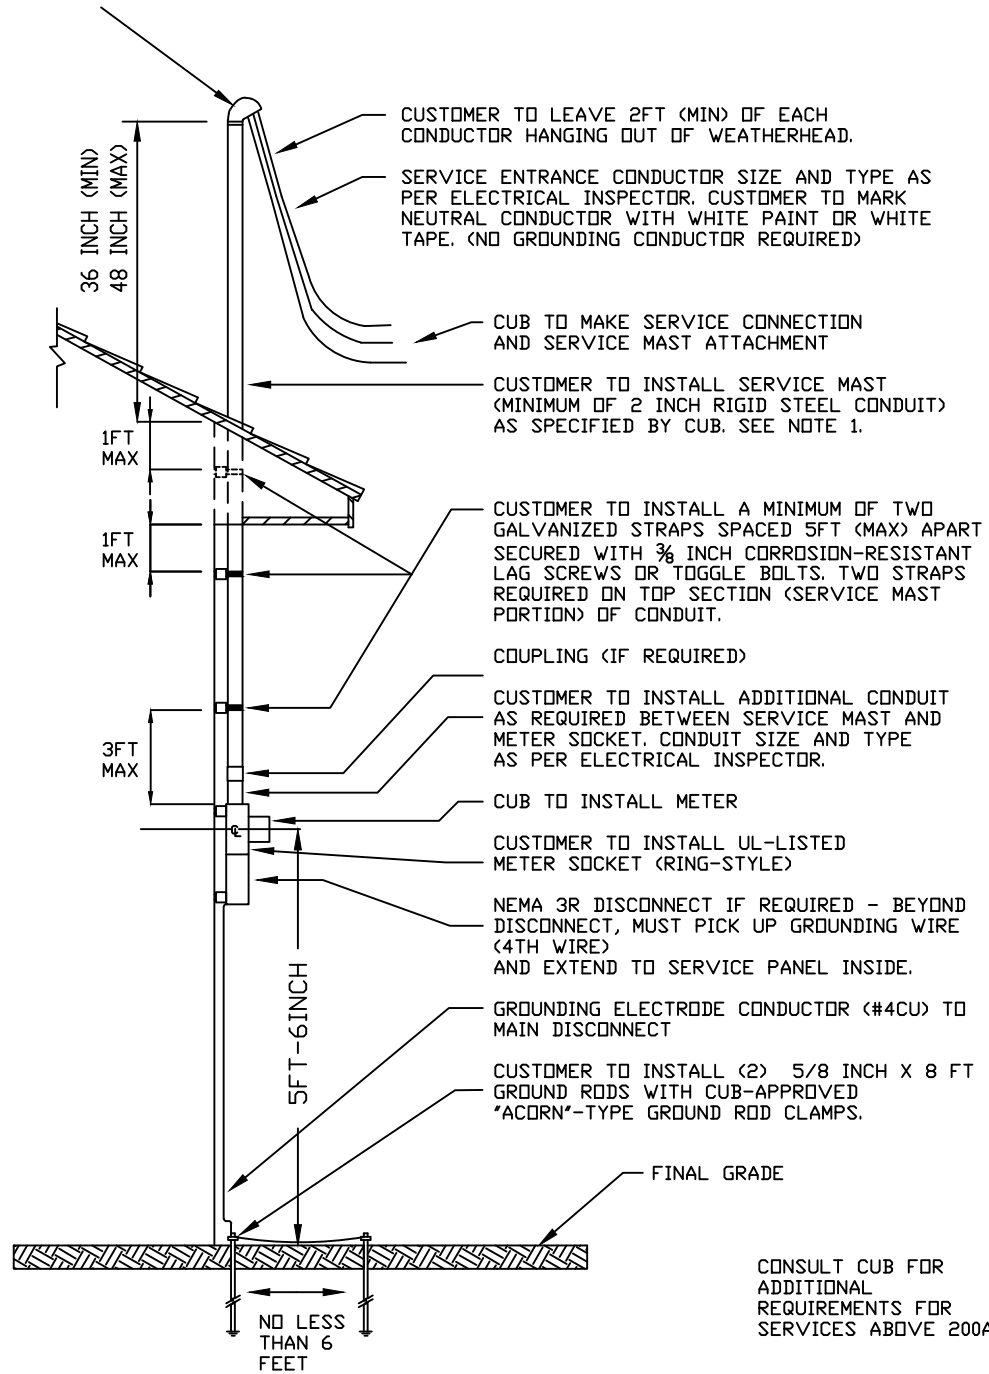

SIDE VIEW

SERVICE ENTRANCE CONDUCTORS	
200A -	2-#2/0CU, 1-#1/0CU NEUT
	OR
	2-#4/0AL, 1-#2/0AL NEUT
NOTE: ENTRANCES ABOVE 200 AMP CONSULT STATE ELECTRICAL INSPECTOR FOR WIRE SIZES	



CLINTON UTILITIES BOARD
 Site Built Home Overhead Service Detail
 1-Phase, 3-Wire, 200A, 120/240 Volts

Rev. Date:	Submitted:	Approved:
Nov 2018	DM	EB

SVC-OHS